


Connection & Installation

Please install the Zener barrier and power supply in a non-hazardous area.
 Use a CVVS-2 core shielded cable (0.75sq or more) for connection.
 And keep the length of the cable between the detector and Zener barrier within 400m.

※ When connecting devices, make sure that each serial number matches.
 When you connecting devices, make sure that each serial number matches.

(Wiring diagram)

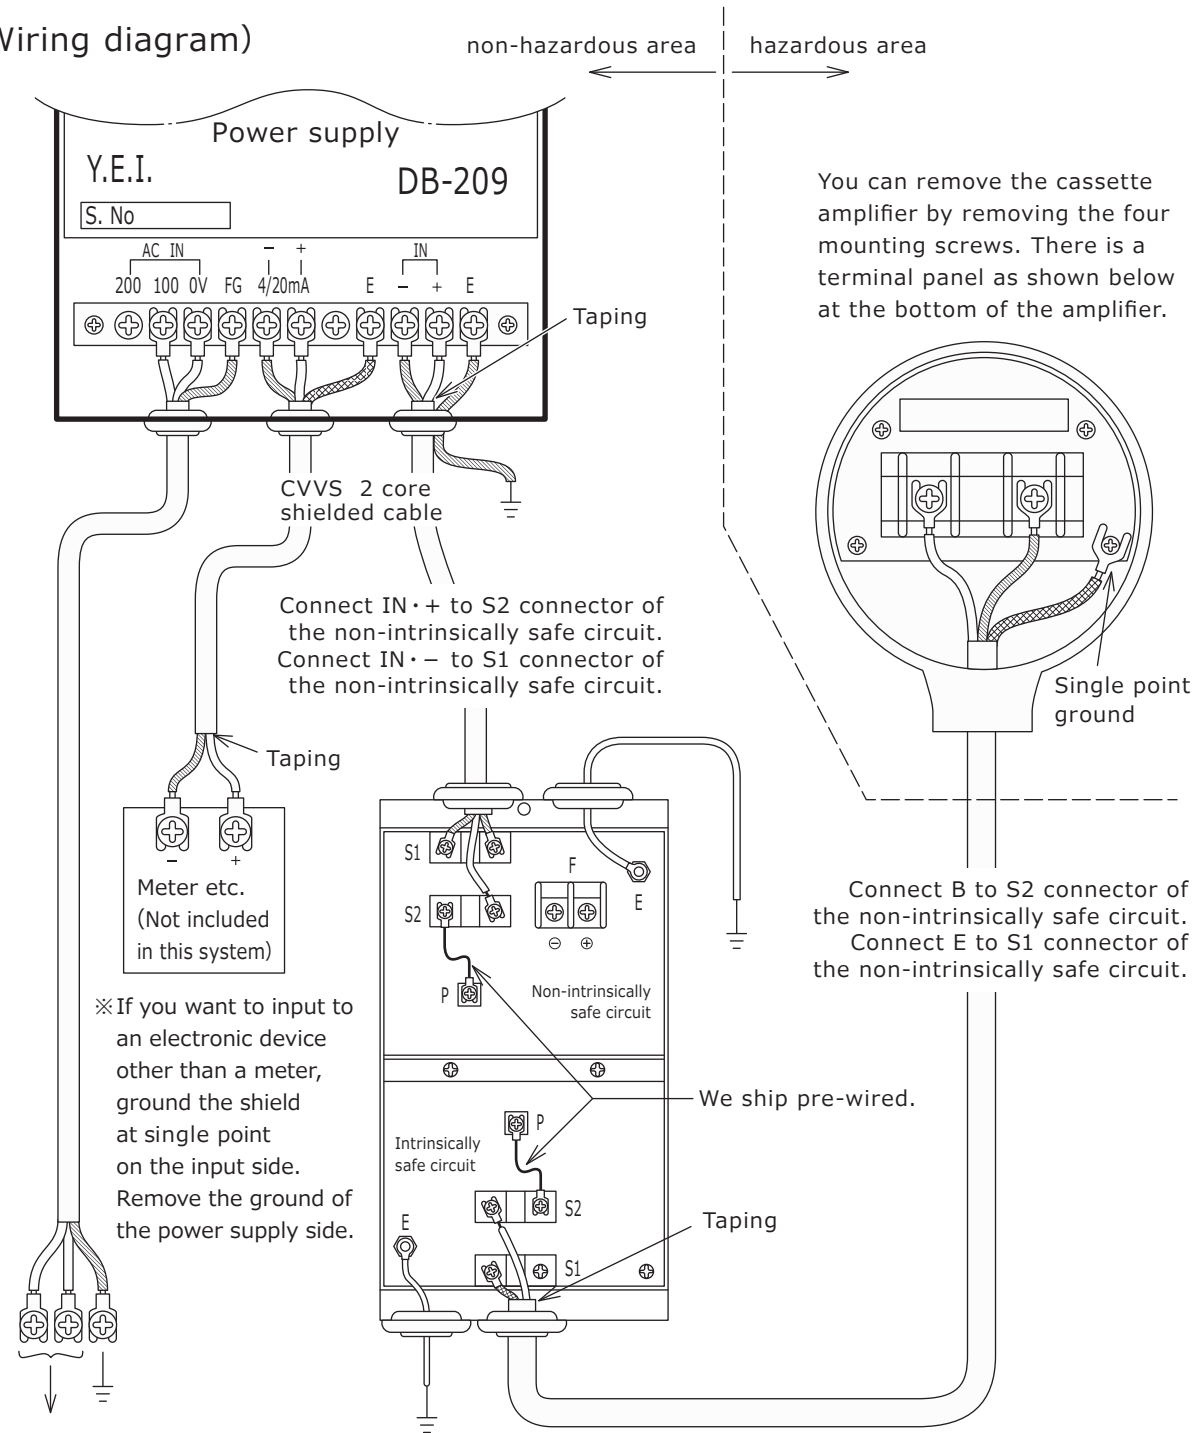

AC power input
 This is an example of 100V input.
 For 200V input, Connect 0V & 200V

Class A ground

CVVS 2 core shielded cable (MAX 400m)

※ Be sure to ground \perp .